T&S BRASS AND BRONZE WORKS, INC.
2 SADDLEBACK COVE / P.O. BOX 1088 / TRAVELERS REST, SC 29690
PHONE 800-476-4103 - FAX 864- 834-3518

REG.#A2601
ISO #9001

Model No.
B-0146
RELIABILITY BUILT IN

Job Name:

Architect/Engineer Approval:

Notes:

EPAct2005 COMPLIANT

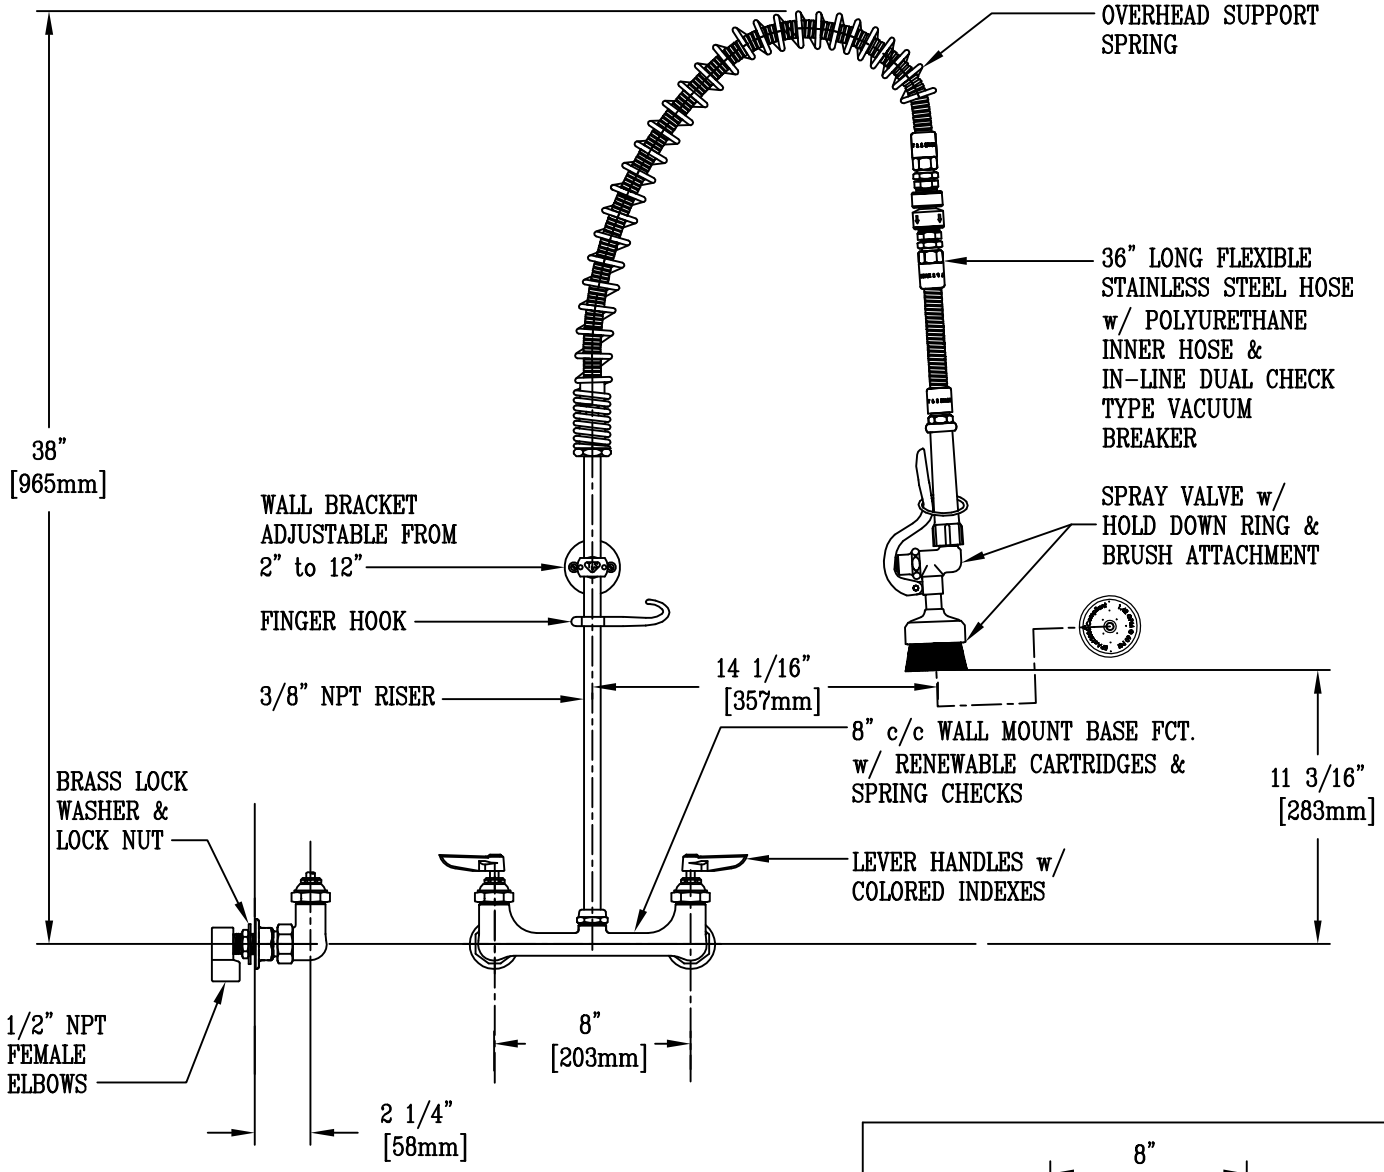

1/2" NPT ATMOSPHERIC TYPE VACUUM BREAKER

RECOMMENDED PRESSURE RANGE: 20-125 PSI.
MAX OPERATING TEMPERATURE 150° F.

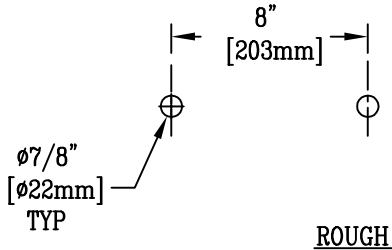

ROUGH IN

Product Description:
8" c/c WALL MOUNT MIXING FAUCET w/ PRE-RINSE ASSEMBLY, SPRAY VALVE, WALL BRACKET & FINGER HOOK, & 1/2" NPT ATMOSPHERIC VACUUM BREAKER

Drawn:	Checked	Scale:
RJK	JRM	1:8
Approved		Date:
JHB		01-04-06