



T&S BRASS AND BRONZE WORKS, INC.

2 SADDLEBACK COVE / P.O. BOX 1088 / TRAVELERS REST, SC 29690

PHONE 800-476-4103

FAX 864-834-3518



Model No.


MV-3000-NW

Item No.:

Job Name:

Architect/Engineer Approval:

Notes:

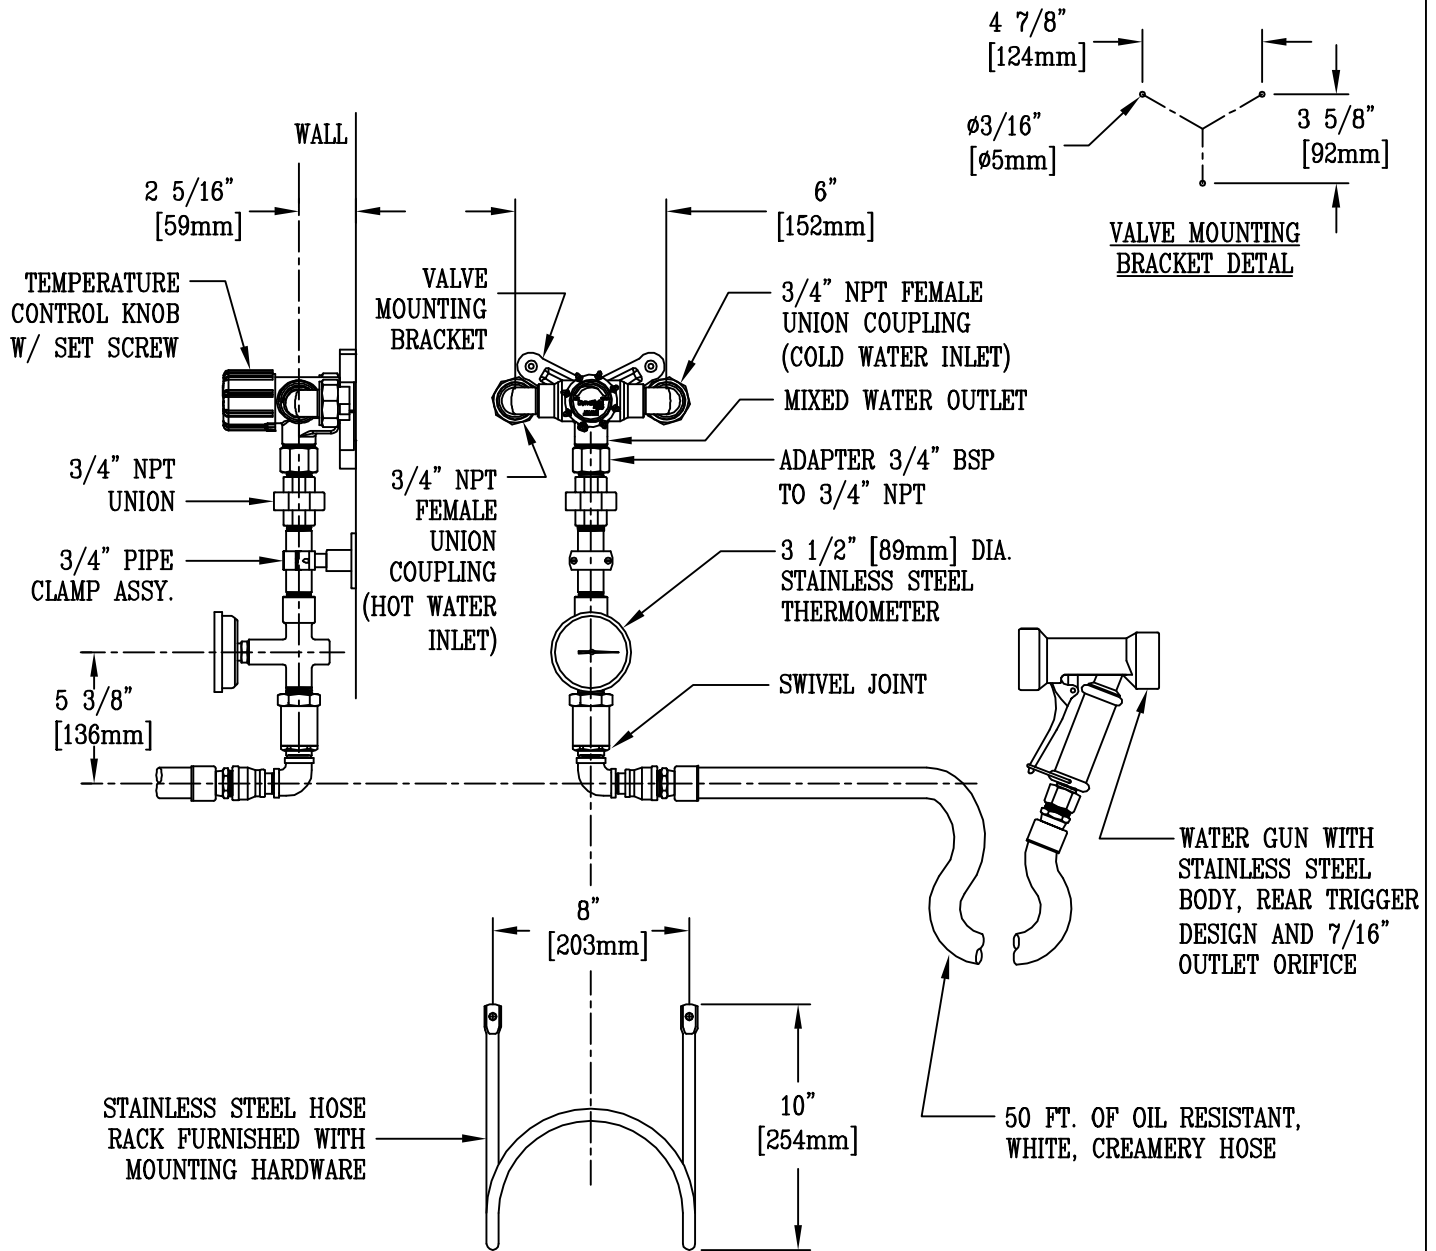

NOTES:

1. MINIMUM OPERATING PRESSURE: 7PSI
2. MAXIMUM OPERATING PRESSURE: 90PSI
3. MAXIMUM STATIC PRESSURE: 150PSI

Product Description:
 WASHDOWN STATION MIXING VALVE,
 3/4" NPT COUPLINGS, NATURAL FINISH,
 TEMP. CONTROL KNOB & CHECK VALVE

Drawn:	Checked:	Scale:
LEL	JKD	1 : 8
Approved:	Date:	
MVW	2/12/03	